



multiCELL - Multi-channel and multi-function transmitter/controller

- Compatible with most common flow, pH/ORP, chlorine and conductivity sensors
- Simple, intuitive user interface with a large adjustable backlit graphics display (4 user defined views)
- Hardware extension possibilities (up to 6 free slots)
- Industrial Ethernet (Modbus TCP, PROFINET or EtherNet/IP) option available
- Functionality extendable by software options

The 8619 multichannel and multifunction transmitter/controller, available in two housing variants for panel or wall mounting, is a microprocessor transmitter/controller for connection of sensors which deliver raw signals for pH, ORP, conductivity and flow via pulses or sensors (like pressure, level, chlorine...) which delivers analogue signals (0...20 mA, 4...20 mA, 0...2 V, 0...5 V, 0...10 V).

Type 8619 is the ideal device for measurement and control and as well dosing processes e.g. in applications of water treatment plants (like boiler, cooling tower or reverse osmosis systems) and food and pharma plants. Modularity in hardware and software offers high flexibility for adjusting it to the applications resulting in having a very good price to functionality relation. Sophisticated electronics and state of the art control algorithms ensure that optimum process control is maintained at all times with minimal operator intervention and achieving highest quality.


Thanks to full support of the Modbus TCP, PROFINET (Conformance Class B) or EtherNet/IP, the 8619 can be integrated into most Industrial Ethernet environments. Therefore all important process values like measurement data, process diagnostics or device status can be easily integrated into the automation system.

| Electrical data | | |
|--|---|---|
| Device version | Panel-mounted – Main module | Wall-mounted – Power supply module |
| Operating voltage ("SUPPLY") | 12...36 V DC ¹⁾ ±10 %, max. 2 A, filtered and regulated, SELV (safety extra low voltage) circuit with a non dangerous energy level | <ul style="list-style-type: none"> 12...36 V DC¹⁾ ±10 %, max. 2 A, filtered and regulated, SELV (safety extra low voltage) circuit with a non dangerous energy level 110...240 V AC, 50...60 Hz, max. 550 mA, integrated protection: 3.15 A time delay fuse ground cable cross-section: 1.5 mm² |
| Power consumption (of multiCELL device - without additional modules and outputs not connected) | Max. 1.5 VA | Max. 2 VA |
| Power charges ("PWR OUT" or "POWER OUT" acc. to version) | 12...36 V DC ¹⁾ , max. 1.8 A protected against polarity reversals | <ul style="list-style-type: none"> 12...36 V DC¹⁾ version: 12...36 V DC¹⁾, max. 1.8 A; protected against polarity reversals 110...240 V AC version: 24 V DC ±2 %, filtered and regulated, SELV (safety extra low voltage) circuit with a non dangerous energy level, max. 1.3 A protected against polarity reversals The allowed max. current depends on the ambient temperature: see diagram below |
| Device version | Panel-mounted – Main module, pH/ORP, conductivity, input and output modules | Wall-mounted – Main module, pH/ORP, conductivity, input and output modules |
| Electrical connection | Terminal blocks or hybrid RJ45 connector | Terminal blocks or RJ45 connector |
| Recommended cable | Cable with maximum operating temperature greater than +90 °C (+194 °F) – External diameter Cross section of <ul style="list-style-type: none"> • Earth connection conductor • Rigid H05(07) V-U • Flexible H05(07) V-K • Conductor with non-insulated lug • Conductor with an insulated lug 0.75...1.5 mm ² 0.2...1.5 mm ² , stripped over 7 mm, shielded cable 0.2...1.5 mm ² , stripped over 7 mm, shielded cable 0.2...1.5 mm ² , stripped over 7 mm, shielded cable 0.2...0.75 mm ² , stripped over 7 mm, shielded cable | Cable with maximum operating temperature greater than +90 °C (+194 °F) 6...12 mm (4 mm if using a multiple entry seal) min. 1.5 mm ² 0.2...1.5 mm ² , stripped over 7 mm, shielded cable 0.2...1.5 mm ² , stripped over 7 mm, shielded cable 0.2...1.5 mm ² , stripped over 7 mm, shielded cable 0.2...0.75 mm ² , stripped over 7 mm, shielded cable |
| Device version | Panel-mounted – Main module | Wall-mounted – Main module |
| Digital inputs DI1, DI2 | Voltage: 0...36 V DC ¹⁾ , input impedance 3 kΩ Switching threshold: Von = 5...36 V DC ¹⁾ , Voff < 2 V DC; Frequency: 0.5...2500 Hz Galvanic insulation, protected against reversed polarity of DC and voltage spikes | Voltage: 0...36 V DC ¹⁾ , input impedance 3 kΩ Switching threshold: Von = 5...36 V DC ¹⁾ , Voff < 2 V DC; Frequency: 0.5...2500 Hz Galvanic insulation, protected against reversed polarity of DC and voltage spikes |
| Digital outputs DO1, DO2 | Transistor: can be wired as PNP or NPN, galvanic insulation, protected against short circuit, max. 36 V DC ¹⁾ , max. 700 mA if 1 DO per module is activated, max. 1 A if the 2 DO's per module are activated, max. 4 A for an Ethernet version if the device has 4 output modules; Operating modes: On/Off, Hysteresis, Window, PWM, PFM, Pulse; Frequency: max. 2000 Hz | Transistor: can be wired as PNP or NPN, galvanic insulation, protected against short circuit, max. 36 V DC ¹⁾ , max. 700 mA if 1 DO per module is activated, max. 1 A if the 2 DO's per module are activated, max. 4 A for an Ethernet version if the device has 4 output modules; Operating modes: On/Off, Hysteresis, Window, PWM, PFM, Pulse; Frequency: max. 2000 Hz |
| Analogue output AO1, AO2 | 4...20 mA, can be wired as sourcing or sinking, galvanic insulation, protected against reversed polarity of DC, max. loop impedance: 860 Ω at 30 V DC, 610 Ω at 24 V DC, 100 Ω at 12 V DC Resolution: 6 µA | 4...20 mA, can be wired as sourcing or sinking, galvanic insulation, protected against reversed polarity of DC, max. loop impedance: 1100 Ω at 36 V DC ¹⁾ , 610 Ω at 24 V DC, 100 Ω at 12 V DC Resolution: 6 µA |
| Memory card Type / Capacity | SD (Secure Digital) or SDHC (Secure Digital High Capacity) / max. 8 GB Note: We recommend to use the 8 GB SDHC memory card available at Burkert (see accessories on page 14) because it has been tested with and validated for the 8619 Transmitter/Controller. Another memory card may not operate correctly. With 8 values recorded every 10 sec., the 8 GB card allows continuous recording over 500 days | |

¹⁾ ! If the device is mounted in a humid environment or outside, then the maximum voltage allowed is **35 V DC** instead of 36 V DC.


Further technical data

Max. allowed current in dependence of the ambient temperature (for wall-mounted version, 110...240 V AC)

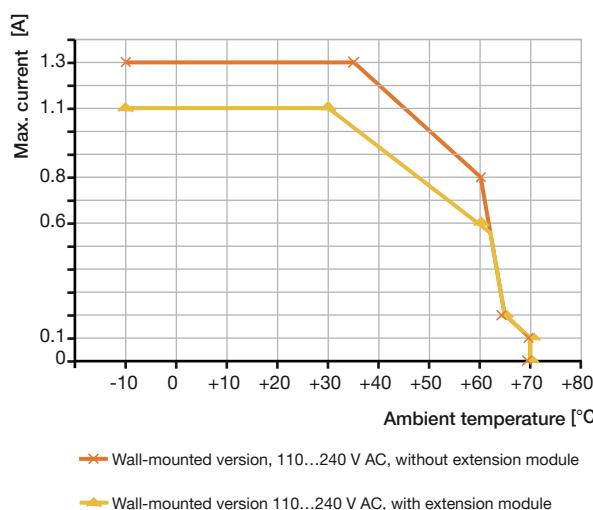


Materials

Panel-mounted (shown with Ethernet version)

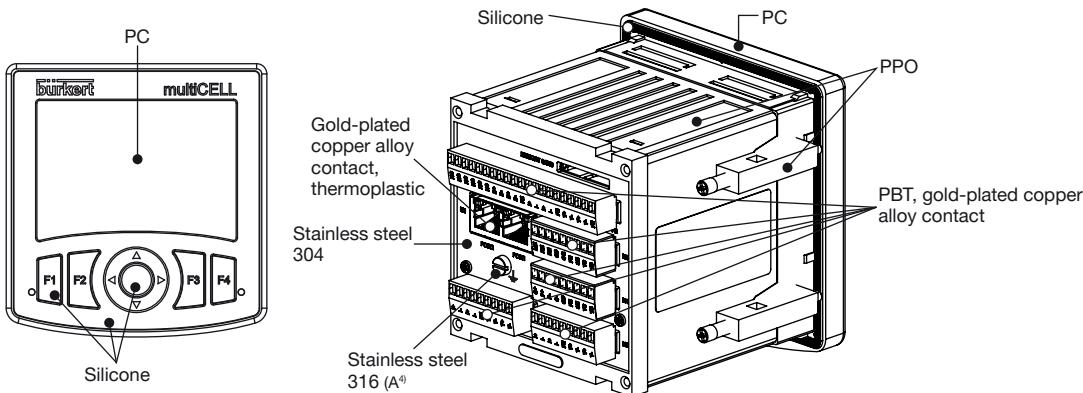

Wall-mounted (shown without Ethernet version)

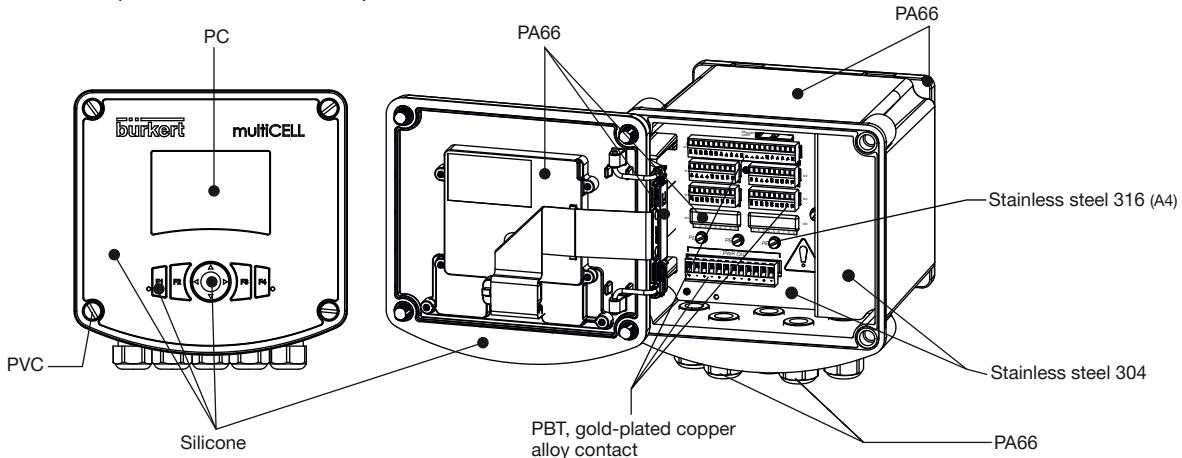

Additional modules

Five different types of modules are available and can be inserted into any of the 6 slots (preconfigured at the factory)

- input module: 2 analogue inputs (4...20 mA or 0...20 mA or 0...2 V or 0...5 V or 0...10 V) and 2 digital inputs (static or frequency/pulse).
- output module: 2 transistor outputs and 2 analogue 4...20 mA outputs
- input pH/ORP and Pt100/Pt1000 modules
- input conductivity and Pt100/Pt1000 modules
- Ethernet module: Modbus TCP, PROFINET Conformance Class B and EtherNet/IP

| Technical data – input module | | Technical data – pH/ORP module | |
|-------------------------------|---|---|---|
| Power consumption | 0.1 VA <th>Power consumption</th> <td>0.1 VA</td> | Power consumption | 0.1 VA |
| Analogue inputs AI1, AI2 | can be wired as sourcing or sinking, galvanic insulation | pH/ORP input | Simultaneous pH and ORP measurement with input for electrochemical pH/ORP |
| Current | range: 0 or 3.5...22 mA max. voltage: 36 V DC ¹⁾ impedance: 50 Ω resolution: 1.5 μA | Temperature input | Pt100/Pt1000, 2 or 3 wires |
| Voltage | range: 0...2 or 5 or 10 V DC max. voltage: 36 V DC ¹⁾ impedance: 110 kΩ resolution: 1 mV | pH measurement Measuring range Resolution Measurement deviation Probe type | -2.0...+16 pH or -600...+600 mV 0.01 pH or 0.1 mV ±0.02 pH or 1 mV + error of the pH probe* electrochemical |
| Error | ±0.25 % of measured value | ORP measurement Measuring range Resolution Measurement deviation Probe type | -2000...+2000 mV 0.1 mV ±1 mV + error of the ORP probe* electrochemical |
| Digital inputs DI1, DI2 | Voltage: 0...36 V DC ¹⁾ , input impedance 3 kΩ Switching threshold : Von = 5...36 V DC ¹⁾ , Voff < 2 V DC; Frequency: 0.5...2500 Hz Galvanic insulation, protected against reversed polarity of DC and voltage spikes | Temperature measurement Measuring range Resolution Measurement deviation Probe type | -25...+130 °C (-20...+266 °F) 0.1 °C (0.18 °F) ±1 °C (1.8 °F) + error of the temperature probe* Pt100/Pt1000, 2 or 3 wires |

* see related probe data sheet

| Technical data – output module | |
|--------------------------------|--|
| Power consumption | Max. 0.1 VA |
| Digital outputs DO1, DO2 | Transistor: can be wired as PNP or NPN, galvanic insulation, protected against short circuit, max. 36 V DC ¹⁾ , max. 700 mA if 1 DO per module is activated, max. 1 A if the 2 DO's per module are activated, max. 4 A for an Ethernet version if the device has 4 output modules; Operating modes: On/Off, Hysteresis, Window, PWM, PFM; Frequency: max. 2000 Hz |
| Analogue output AO1, AO2 | 4...20 mA, can be wired as sourcing or sinking, galvanic insulation, protected against reversed polarity of DC, max. loop impedance: 1100 Ω at 36 V DC ¹⁾ , 610 Ω at 24 V DC, 100 Ω at 12 V DC Resolution: 6 μA |
| 4...20 mA output uncertainty | ±0.5 % of the transmitted value |

* see related probe data sheet

| Technical data – conductivity module | |
|---|---|
| Resistance measurement | (without conductivity probe connected) 5.0 Ω...1 MΩ |
| Power consumption | 0.25 VA |
| Conductivity input | Operation with 2 or 4 pin technology sensors |
| Temperature input | Pt100/Pt1000, 2 or 3 wires |
| Conductivity measurement Measuring range Resolution Measurement deviation | (with connected conductivity probe) 0 μS/cm...2 S/cm (depending on the conductivity cell) 1 nS/cm ±0.5 % of measured value + error of the conductivity probe* |
| Resistivity measurement Measuring range Resolution Measurement deviation | (with connected conductivity probe) 0.5 Ω.cm...100 MΩ.cm (depending on the conductivity cell) 0.1 Ω.cm ±0.5 % of measured value + error of the conductivity probe* |
| Temperature measurement Measuring range Resolution Measurement deviation Probe type | -40...+200 °C (-40...+392 °F) 0.1 °C (0.18 °F) ±1 °C (1.8 °F) + error of the temperature probe* Pt100/Pt1000, 2 or 3 wires |

* see related probe data sheet

¹⁾ If the device is mounted in a humid environment or outside, then the maximum voltage allowed is **35 V DC** instead of 36 V DC.

| Technical data – Ethernet module | | Environment conditions – Main module, pH/ORP, conductivity, input, output and Ethernet modules | |
|------------------------------------|---|---|--|
| Power consumption | 2.2 VA | Ambient temperature | |
| Supported network protocols | Modbus TCP, PROFINET or EtherNet/IP | Operation (with/without memory card) Only Main module | <ul style="list-style-type: none"> • Panel-mounted and 110...240 V AC wall-mounted version: -10...+70 °C (+14...+158 °F) • 12...36 V DC¹⁾ wall-mounted version: -10...+75 °C (+14...+167 °F) |
| LEDs | <ul style="list-style-type: none"> • 2 Link/Act LEDs (yellow) • 2 Link LEDs (green) | Min. 1 additional module | <ul style="list-style-type: none"> • all versions: -10...+60 °C (+14...+140 °F) |
| Electrical connection | 2 ports for an RJ45 connector (Not provided – Note: to make sure the door of a wall-mounted Ethernet version can be fully closed, use RJ45 male connectors with maximum dimensions of 45 mm, including the bend radius of the Ethernet cable.) | Storage | <ul style="list-style-type: none"> • all versions: -20...+70 °C (-4...+140 °F), limited to -10...+70 °C (+14...+140 °F) if memory card is inserted |
| Recommended cable | Shielded cable Minimum category Length | Relative humidity | <85 %, without condensation |
| | minimum required: FTP 5e / CAT-5 maximum 100 m | Height above sea level | max. 2000 m |
| Modbus TCP protocol | Internet protocol, version 4 (IPv4) <ul style="list-style-type: none"> • Tree • Star • Line (open daisy chain) • Fixed IP • BOOTP (Bootstrap Protocol) • DHCP (Dynamic Host Configuration) 10 or 100 MBit/s | * ^s if a different memory card is used, observe the operating temperatures specified by its manufacturer | |
| PROFINET protocol | V2.3 <ul style="list-style-type: none"> • Tree • Star • Ring (closed daisy chain) • Line (open daisy chain) <ul style="list-style-type: none"> • LLDP (Link Layer Discovery Protocol) • SNMP V1 (Simple Network Management Protocol) • MIB (Management Information Base) • DCP (Discovery and Configuration Protocol) • Manual (Device naming and IP setting) 100 MBit/s full duplex CC-B MRP client is supported Available at / Download from: www.bürkert.com | Standards, directives and certifications – Main module, pH/ORP, conductivity, input, output and Ethernet modules | |
| | | Protection class | acc. to EN 60529 |
| | | Panel-mounted version | IP65 (panel-mounted, cabinet closed) IP20 (panel-mounted, inside the cabinet) NEMA250 4X (panel-mounted, in front of the closed cabinet) IP65, IP67, if the following conditions are met: <ul style="list-style-type: none"> - glands body tightened with a tightening torque of 5.5 Nm ±20 %, made at factory - glands blanked off or wired - gland nuts tightened with a tightening torque of 4.5 Nm ±20 % - housing closed - 4 screws of cover cross tightened with a tightening torque of 1.4 Nm ±20 % |
| | | Wall-mounted version | |
| | | Standard and directives CE | The applied standards, which verify conformity with the EU Directives, can be found on the EU Type Examination Certificate and/or the EU Declaration of conformity (if applicable) |
| | | Certifications |  Measuring Equipment E237737 61010-1 + CAN/CSA-C22.2 No. 61010-1 |
| | | PROFINET |  PROFINET Z11949 |
| | | EtherNet/IP |  |

¹⁾ ! If the device is mounted in a humid environment or outside, then the maximum voltage allowed is **35 V DC** instead of 36 V DC.

Specific technical data of UL-Listed products for US and Canada
Intended for an inner pollution input


V DC version
V AC version

Pollution degree 2 acc. to EN 61010-1
Pollution degree 3 acc. to EN 61010-1 if the following conditions are met:
- housing tightly closed.
- the 4 screws of the cover are tightened crosswise at a torque of 1.4 Nm $\pm 20\%$

Installation category


V DC version
V AC version

Category I according to UL 61010-1
Category II according to UL 61010-1

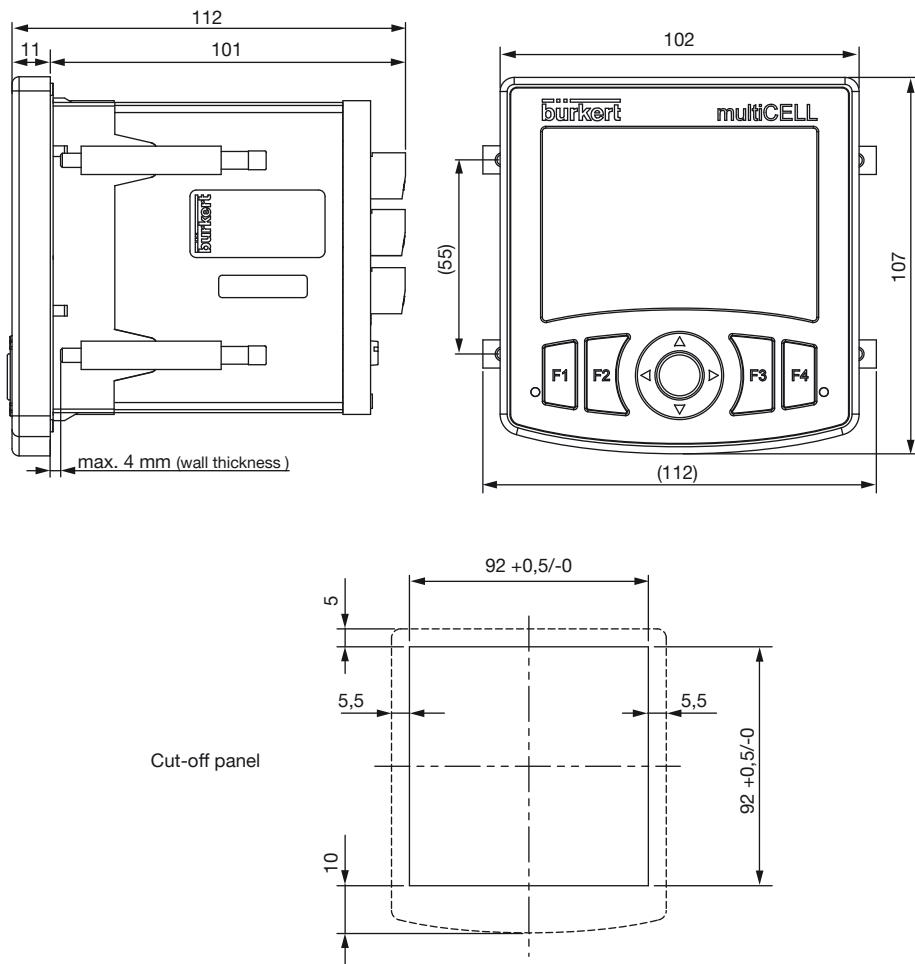Dimensions [mm]
Panel-mounted


Dimensions [mm]

Wall-mounted

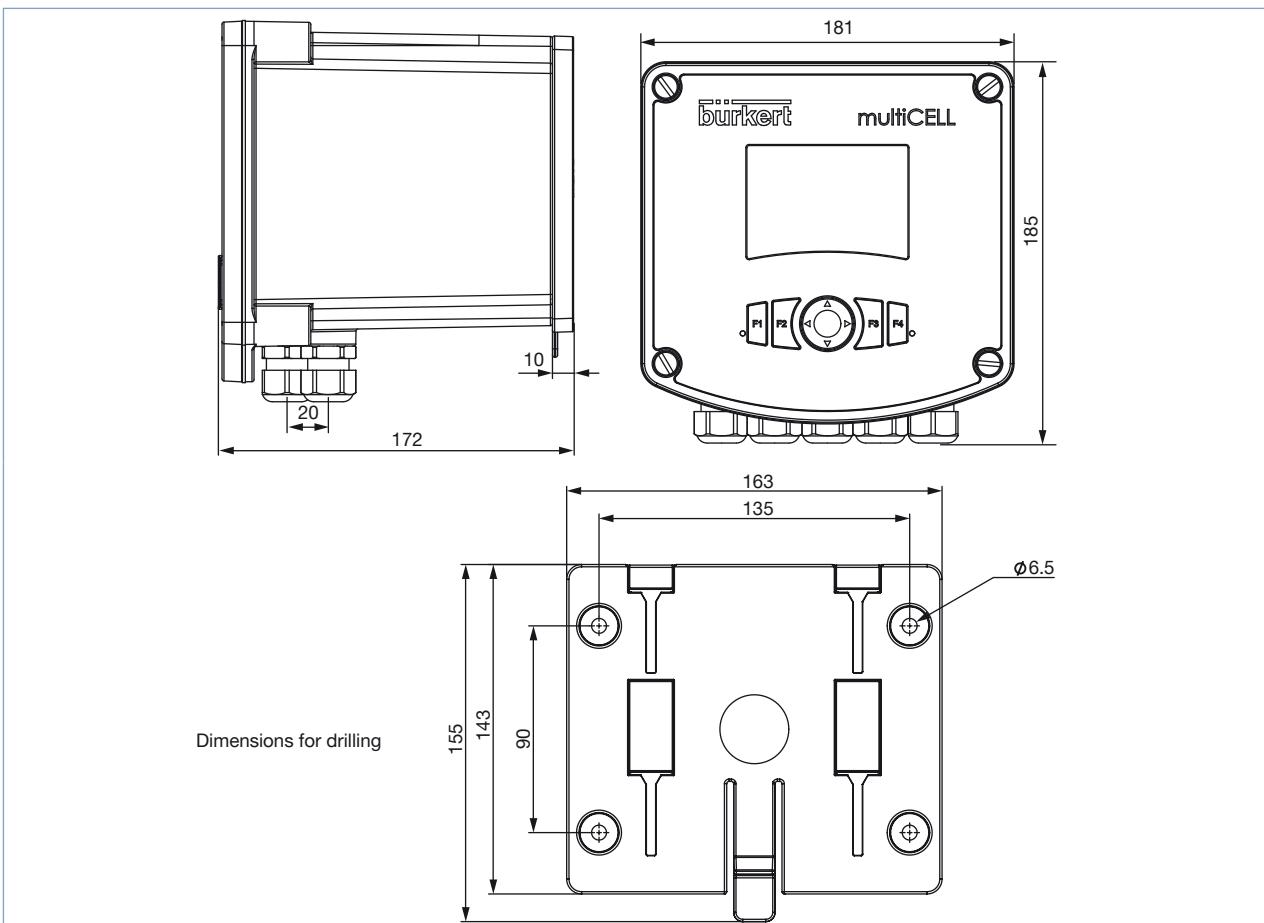

The housing variant for wall mounting can also be installed on a pipe using a mounting set (has to be ordered separately, see accessories on page 14).

Principle of operation

Thanks to its modular internal structure, the transmitter/controller is able to manage, in parallel, different types of sensors and selectively perform operations on the measured values. Multiple tasks can be performed in parallel; from a simple measurement, to a standard output signal, to the assignment of mathematical formulas for selectable values for controlling and dosing. The signal and function modules can be easily connected to each other by configuration. Thanks to individual parameterization, all functions can be adapted to the actual process conditions.

The basic unit is either a panel-mounted version or a wall-mounted version. It has analogue and digital outputs, digital inputs and its front panel has a backlit graphic display. Depending on the application, up to 6 slots are available in which pH/Redox, conductivity, analog and digital output modules, additional analog and digital input boards, and industrial Ethernet modules can be installed. There is no need for a separate 4...20 mA transmitter: the pH, conductivity modules accept raw signals from sensors.

Though highly functional the multiCELL can be operated easily and intuitively. The base for this is the large graphical display and the dynamically assigned function keys. Clearly arranged menu and module structures allow for easy configuration and setup of parameters and offer a high transparency for the functions in use. Four user views can be configured. This allows the user to design a view himself displaying a value arrangement which he likes to see simultaneously and this can be available 4 times and independent from each other.

For data collection and storage e.g. of measurement values there is an optional data logger available which uses the memory card if inserted in the card slot. Uploading and restoring the complete database of the complete 8619, including the special parameter settings of the application and the updating firmware via the memory card is available as standard.

Fully integration into the automation system can be realized with the optional available Industrial Ethernet Module. The protocols Modbus TCP and PROFINET Conformance Class B and EtherNet/IP are fully supported. Thanks to generic configuration files, routing within the PLC can be easily done.

Construction

The main module slot enables:

- connection to the transmitter/controller power supply
- to power another device
- the use of 2 digital inputs (DI), 2 analogue (AO) and 2 digital (DO) outputs



Memory card slot:


- For upload and download of parameter settings
 - Software updates and functional upgrades
- Simple operation: insert the memory card into the slot on the rear of the device.

Additional module slots (up to 6) to choose among:

- module for conductivity sensor and/or temperature sensor (green connector)
- module for pH/ORP sensor and/or temperature sensor (light grey connector)
- module for 2 analogue and 2 digital outputs (black connector)
- module for 2 analogue and 2 digital inputs (orange connector)
- module for Industrial Ethernet (2 RJ45 connectors)*

The main module slot enables:

- the use of 2 digital inputs (DI), 2 analogue (AO) and 2 digital (DO) outputs

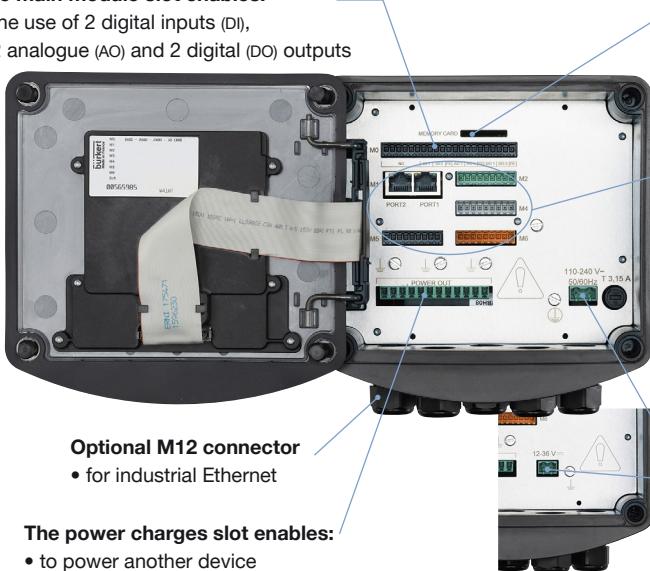

Memory card slot:

- For upload and download of parameter settings
 - Software updates and functional upgrades
- Simple operation: insert the memory card into the slot on the rear of the device.

Additional module slots up to 6) to choose among:

- module for conductivity sensor and/or temperature sensor (green connector)
- module for pH/ORP sensor and/or temperature sensor (light grey connector)
- module for 2 analogue and 2 digital outputs (black connector)
- module for 2 analogue and 2 digital inputs (orange connector)
- module for Industrial Ethernet (2 RJ45 connectors)*


The power supply slot enables:

- connection to the transmitter/controller power supply (behind the protecting cover for 110...240 V AC version)

¹ Ethernet module takes two slots

The Ethernet module is available from Software version B.00.01


Process diagram

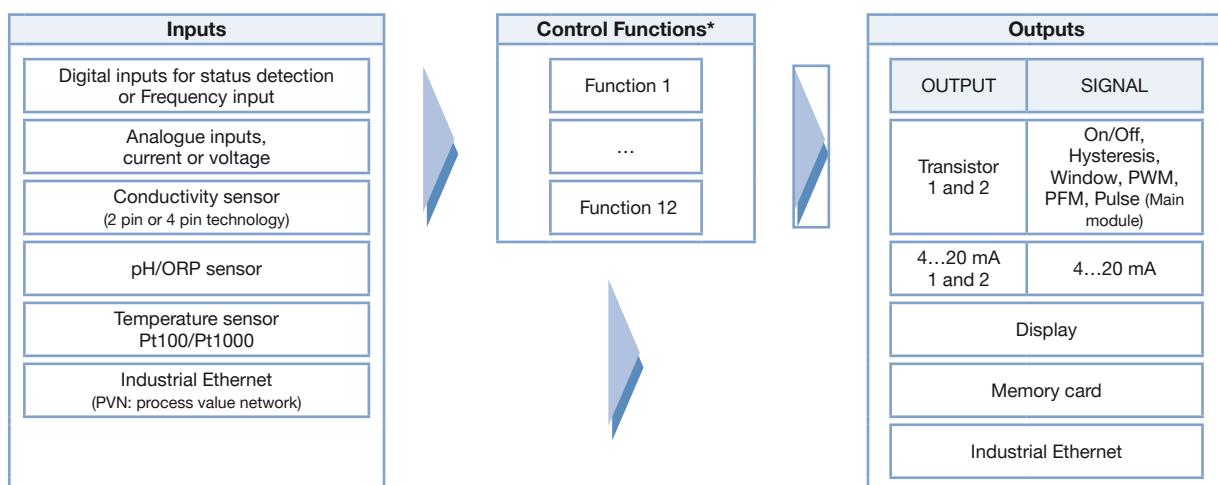

* The 12 functions can be activated simultaneously and independently, and up to 6 PID functions can be set; if this option is selected.


List of available functions

The transmitter/controller allows to allocate each sensor signal to a function fully configurable by the user (such as dosage, for example). According to the model the following functions are available as standard or as option

| Functions | Availability | Formula | Example for usage |
|---|--|---|---|
| Arithmetic | Basic for all models | A+B, A-B, A*B, A/B | Arithmetic operation (addition, subtraction, multiplication and division) between 2 values. For addition and subtraction, the 2 values must have the same units, but for multiplication and division not necessarily. A and B can be constants, measured physical parameters, results of other active configured functions, the previous result of the same function, values sent by a PLC (PVN). The multiplication function is available from Software version B.00.01 |
| PASS | Basic for all models | A/B[%] | A and B must have the same units and can be constants, measured physical parameters, results of other active configured functions, the previous result of the same function, values sent by a PLC (PVN) Calculates a flow ratio between 2 values. e.g: reverse osmosis |
| REJECT | Basic for all models | (1-A/B)[%] | A and B must have the same units and can be constants, measured physical parameters, results of other active configured functions, the previous result of the same function, values sent by a PLC (PVN) Calculates a reject ratio between 2 values. e.g: reverse osmosis |
| DEVIAT | Basic for all models | (A/B-1)[%] | Calculates a deviation ratio between 2 values. |
| MATH | As option | Permits to enter an equation which respects the following rules: <ul style="list-style-type: none"> • up to 125 characters; • up to 5 process values (A, B, C, D & E) • with possible operators: () ! ± ^ × ÷ % + - < > ≤ ≥ | A, B, C, D, E can be constants, measured physical parameters, results of other active configured functions, the previous result of the same function, values sent by a PLC (PVN) e.g: (A*B)+(C*D)-E |
| PROP | Basic for all models |  | Calculates an output in proportion to a scaled input |
| ON/OFF | Basic for all models | On/Off control loop | For any type of input |
| Flow rate measurement | As base for model item no. 560 205, 560 213, 565 984, 565 985, 565 986, 565 987 for others as option | | Allows both digital inputs to be used as frequency inputs for flow measurement (in standard for base unit) OR coexistent with analytical modules (in option for others devices) |
| PID | As option | Continuous control loop | For any type of input and with internal or external setpoint |
| Time dosing | As option | | e.g. for cooling tower application. Dosing of 1 or 2 biocides in the circuits, at fixed time intervals or by defining dosing during one week, with 2 dosings per day. Can be connected to an ON/OFF conductivity function for prebleed. |
| Special Chemical batch (Volume dosing) | As option | | Specifically for cooling tower application. A defined volume of water is counted, then an actuator is energized during a defined time to add a chemical and the water volume being counted is resetted. |
| Concentration | As option | | The concentration curves of NaCl, H ₂ SO ₄ , HNO ₃ , NaOH, HCl are implemented for use in complete concentration range and not only in low concentration. |
| Data logging on memory card | As option | | Up to 16 values can be stored at a defined time interval. |

Concentration tables multiCELL

If multiCELL 8619 is equipped with a conductivity module, multiCELL is able to calculate the concentration depending on the measured conductivity and temperature. Therefore concentration tables for binary mixtures of (five) different substances and water are available. Determine the best suited concentration range (out of ten ranges) for your application.

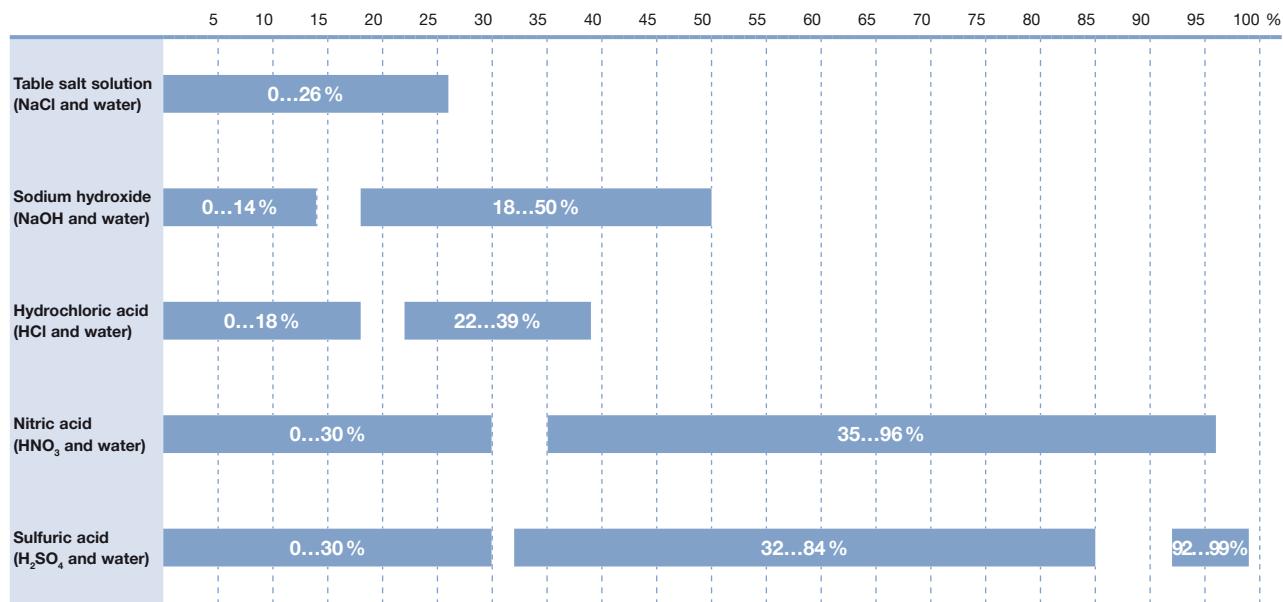

Ordering chart for multiCELL transmitter/controller, Type 8619

Notes regarding the ordering of below mentioned multiCELL transmitter/controller:

- The below items are equipped of arithmetic, PASS, REJECT, DEVIAT, MATH, PROP, ON/OFF functions in standard (see List of available functions, p. 9).

In the BASE unit the Flow measurement function is also a standard function, the other functions are available as option.

Please also use the "request for quotation" form on page 16 for ordering a device with additional options.

- If a totalizer function is required then a Flowmeter has to be connected via a digital input (main module or input module)

Panel-mounted version, 12...36 V DC¹⁾

| Description | Digital (DI) (On/Off or frequency) | Inputs | | Pt100/ Pt1000 | Outputs | | Network protocol | UL ²⁾ certification | Article no. |
|--|---|---|---|------------------|--|-------------------------------|---------------------------|-----------------------------------|-------------|
| | | Analogue (AI) 0/4...20 mA current and/or 0...2, 0...5, 0...10 V DC voltage | Number and type of sensor raw signals | | Transistor (DO) (PWM or PFM or On/Off or pulse) | Analogue (AO) 4...20 mA | | | |
| Base unit with flow measurement (Main module) | 2 | — | — | — | 2 | 2 | — | No | 560205 |
| | | | | | | | | Yes | 560213 |
| Main module + 1 pH/ORP module | 2 | — | 1 (pH/ORP) | 1 | 2 | 2 | — | No | 560200 |
| | | | | | | | | Yes | 560208 |
| Main module + 2 pH/ORP modules + 1 output module | 2 | — | 2 (pH/ORP) | 2 | 4 | 4 | — | No | 560202 |
| | | | | | | | | Yes | 560210 |
| Main module + 1 conduc- tivity module | 2 | — | 1 (cond.) | 1 | 2 | 2 | — | No | 560201 |
| | | | | | | | | Yes | 560209 |
| Main module + 2 conduc- tivity modules + 1 output module | 2 | — | 2 (cond.) | 2 | 4 | 4 | — | No | 560203 |
| | | | | | | | | Yes | 560211 |
| Main module + 1 pH/ORP module + 1 conductivity module + 1 output module | 2 | — | 1 (pH/ORP) + 1 (cond.) | 2 | 4 | 4 | — | No | 560204 |
| | | | | | | | | Yes | 560212 |
| Main module + 1 input module | 4 | 2 | — | — | 2 | 2 | — | No | 563960 |
| | | | | | | | | Yes | 563961 |
| Main module + 1 pH/ORP module + 1 input module + 1 output module | 4 | 2 | 1 (pH/ORP) | 1 | 4 | 4 | — | No | 563962 |
| | | | | | | | | Yes | 563963 |
| Main module + 1 conduc- tivity module + 1 input module + 1 output module | 4 | 2 | 1 (cond.) | 1 | 4 | 4 | — | No | 563964 |
| | | | | | | | | Yes | 563912 |
| Main module + 1 Ethernet module | 2 | — | — | — | 2 | 2 | Modbus TCP ³⁾ | No | 569259 |
| | | | | | | | PROFINET ⁴⁾ | No | 569260 |
| | | | | | | | EtherNet/IP ⁴⁾ | Yes | 569261 |
| Main module + 1 pH/ ORP module + 1 Ethernet module | 2 | — | 1 (pH/ORP) | 1 | 2 | 2 | Modbus TCP ³⁾ | No | 569265 |
| | | | | | | | PROFINET ⁴⁾ | No | 569266 |
| | | | | | | | EtherNet/IP ⁴⁾ | Yes | 569267 |
| Main module + 1 conduc- tivity module + 1 Ethernet module | 2 | — | 1 (cond.) | 1 | 2 | 2 | Modbus TCP ³⁾ | No | 569262 |
| | | | | | | | PROFINET ⁴⁾ | No | 569263 |
| | | | | | | | EtherNet/IP ⁴⁾ | Yes | 569264 |

¹⁾ If the device is mounted in a humid environment or outside, then the maximum voltage allowed is 35 V DC instead of 36 V DC.

²⁾ UL-Listed (Measuring Equipment E237737).

³⁾ If you order a device with a Modbus TCP network protocol, it does not include the other 2. If you would then like to change it with a PROFINET or EtherNet/IP network, the Ethernet protocol must be ordered (see Ordering chart for additional software functions, see page 14).

⁴⁾ If you order a device with a PROFINET or EtherNet/IP network protocol, it also contains the other two.

Ordering chart for multiCELL transmitter/controller, Type 8619**Wall-mounted version, 12...36 V DC¹⁾**

| Description | Digital (DI) (On/Off or frequency) | Inputs | | Pt100/ Pt1000 | Outputs | | Network protocol | UL ²⁾ certification | Article no. |
|---|---|---|---|------------------|--|-------------------------------|---------------------------|-----------------------------------|-------------|
| | | Analogue (AI) 0/4...20 mA current and/or 0...2, 0...5, 0...10 V DC voltage | Number and type of sensor raw signals | | Transistor (DO) (PWM or PFM or On/Off or pulse) | Analogue (AO) 4...20 mA | | | |
| Base unit with flow measurement (Main module) | 2 | — | — | — | 2 | 2 | — | No | 565984 |
| | | | | | | | | Yes | 565986 |
| Main module + 1 pH/ORP module | 2 | — | 1 (pH/ORP) | 1 | 2 | 2 | — | No | 565988 |
| | | | | | | | | Yes | 565990 |
| Main module + 2 pH/ORP modules + 1 output module | 2 | — | 2 (pH/ORP) | 2 | 4 | 4 | — | No | 565992 |
| | | | | | | | | Yes | 565994 |
| Main module + 1 conductivity module | 2 | — | 1 (cond.) | 1 | 2 | 2 | — | No | 565996 |
| | | | | | | | | Yes | 565998 |
| Main module + 2 conductivity modules + 1 output module | 2 | — | 2 (cond.) | 2 | 4 | 4 | — | No | 566000 |
| | | | | | | | | Yes | 566002 |
| Main module + 1 pH/ORP module + 1 conductivity module + 1 output module | 2 | — | 1 (pH/ORP) + 1 (cond.) | 2 | 4 | 4 | — | No | 566004 |
| | | | | | | | | Yes | 566006 |
| Main module + 1 input module | 4 | 2 | — | — | 2 | 2 | — | No | 566008 |
| | | | | | | | | Yes | 566010 |
| Main module + 1 pH/ORP module + 1 input module + 1 output module | 4 | 2 | 1 (pH/ORP) | 1 | 4 | 4 | — | No | 566012 |
| | | | | | | | | Yes | 566014 |
| Main module + 1 conductivity module + 1 input module + 1 output module | 4 | 2 | 1 (cond.) | 1 | 4 | 4 | — | No | 566016 |
| | | | | | | | | Yes | 566018 |
| Main module + 1 Ethernet module | 2 | — | — | — | 2 | 2 | Modbus TCP ³⁾ | No | 569268 |
| | | | | | | | PROFINET ⁴⁾ | No | 569269 |
| | | | | | | | EtherNet/IP ⁴⁾ | Yes | 569270 |
| Main module + 1 pH/ORP module + 1 Ethernet module | 2 | — | 1 (pH/ORP) | 1 | 2 | 2 | Modbus TCP ³⁾ | No | 569274 |
| | | | | | | | PROFINET ⁴⁾ | No | 569275 |
| | | | | | | | EtherNet/IP ⁴⁾ | Yes | 569276 |
| Main module + 1 conductivity module + 1 Ethernet module | 2 | — | 1 (cond.) | 1 | 2 | 2 | Modbus TCP ³⁾ | No | 569271 |
| | | | | | | | PROFINET ⁴⁾ | No | 569272 |
| | | | | | | | EtherNet/IP ⁴⁾ | Yes | 569273 |

¹⁾ If the device is mounted in a humid environment or outside, then the maximum voltage allowed is 35 V DC instead of 36 V DC.²⁾ UL-Listed (Measuring Equipment E237737).³⁾ If you order a device with a Modbus TCP network protocol, it does not include the other 2. If you would then like to change it with a PROFINET or EtherNet/IP network, the Ethernet protocol must be ordered (see Ordering chart for additional software functions, see page 14).⁴⁾ If you order a device with a PROFINET or EtherNet/IP network protocol, it also contains the other two.

Ordering chart for multiCELL transmitter/controller, Type 8619**Wall-mounted version, 110...240 V AC**

| Description | Digital (DI) (On/Off or frequency) | Inputs | | Pt100/ Pt1000 | Outputs | | Network protocol | UL ¹⁾ certification | Article no. |
|--|---|---|---|------------------|--|-------------------------------|---------------------------|-----------------------------------|-------------|
| | | Analogue (AI) 0/4...20 mA current and/or 0...2, 0...5, 0...10 V DC voltage | Number and type of sensor raw signals | | Transistor (DO) (PWM or PFM or On/Off or pulse) | Analogue (AO) 4...20 mA | | | |
| Base unit with flow measurement (Main module) | 2 | — | — | — | 2 | 2 | — | No | 565985 |
| | | | | | | | | Yes | 565987 |
| Main module + 1 pH/ORP module | 2 | — | 1 (pH/ORP) | 1 | 2 | 2 | — | No | 565989 |
| | | | | | | | | Yes | 565991 |
| Main module + 2 pH/ORP modules + 1 output module | 2 | — | 2 (pH/ORP) | 2 | 4 | 4 | — | No | 565993 |
| | | | | | | | | Yes | 565995 |
| Main module + 1 conduc- tivity module | 2 | — | 1 (cond.) | 1 | 2 | 2 | — | No | 565997 |
| | | | | | | | | Yes | 565999 |
| Main module + 2 conduc- tivity modules + 1 output module | 2 | — | 2 (cond.) | 2 | 4 | 4 | — | No | 566001 |
| | | | | | | | | Yes | 566003 |
| Main module + 1 pH/ORP module + 1 conductivity module + 1 output module | 2 | — | 1 (pH/ORP) + 1 (cond.) | 2 | 4 | 4 | — | No | 566005 |
| | | | | | | | | Yes | 566007 |
| Main module + 1 input module | 4 | 2 | — | — | 2 | 2 | — | No | 566009 |
| | | | | | | | | Yes | 566011 |
| Main module + 1 pH/ORP module + 1 input module + 1 output module | 4 | 2 | 1 (pH/ORP) | 1 | 4 | 4 | — | No | 566013 |
| | | | | | | | | Yes | 566015 |
| Main module + 1 conduc- tivity module + 1 input module + 1 output module | 4 | 2 | 1 (cond.) | 1 | 4 | 4 | — | No | 566017 |
| | | | | | | | | Yes | 566019 |
| Main module + 1 Ethernet module | 2 | — | — | — | 2 | 2 | Modbus TCP ²⁾ | No | 569277 |
| | | | | | | | PROFINET ³⁾ | No | 569278 |
| | | | | | | | EtherNet/IP ³⁾ | Yes | 569279 |
| Main module + 1 pH/ ORP module + 1 Ethernet module | 2 | — | 1 (pH/ORP) | 1 | 2 | 2 | Modbus TCP ²⁾ | No | 569283 |
| | | | | | | | PROFINET ³⁾ | No | 569284 |
| | | | | | | | EtherNet/IP ³⁾ | Yes | 569285 |
| Main module + 1 conduc- tivity module + 1 Ethernet module | 2 | — | 1 (cond.) | 1 | 2 | 2 | Modbus TCP ²⁾ | No | 569280 |
| | | | | | | | PROFINET ³⁾ | No | 569281 |
| | | | | | | | EtherNet/IP ³⁾ | Yes | 569282 |

¹⁾ UL-Listed (Measuring Equipment E237737).²⁾ If you order a device with a Modbus TCP network protocol, it does not include the other 2. If you would then like to change it with a PROFINET or EtherNet/IP network, the Ethernet protocol must be ordered (see Ordering chart for additional software functions, see page 14).³⁾ If you order a device with a PROFINET or EtherNet/IP network protocol, it also contains the other two.

Ordering chart for additional software functions for Type 8619

Use the following order codes only in case you already own a 8619 and you like to add one or more functions to your device.

! Please don't forget to note down the Article no. and serial number (see the device label) of your multiCELL on your order.


| Software option | Remark | Article no. |
|---|--|-------------|
| PID control | — | 561836 |
| Data Logger | SD card is not included. | 561837 |
| Chemical dosing (e.g. cooling tower) | The "Dosing" option also activates the "Flow" option if it does not exist by default in the device. | 561838 |
| Flow measurement | Is already included in the base unit device (560205 and 560213) | 561839 |
| Concentration measurement of selected fluids | Requires at least one conductivity hardware module | 561840 |
| Protocols Ethernet: Modbus TCP, PROFINET, EtherNet/IP | Ethernet-Module takes 2 slots. (Available only from Software version B.00.01; Already included in the device with a PROFINET or EtherNet/IP network protocol) | 569286 |
| MATH function | — | 569848 |

Remark: the function upload and download of the complete data set of the 8619 is available as standard and does not need the data logger option

Ordering chart for accessories for Type 8619

| Description | Article no. |
|---|-------------|
| SDHC Memory Card - Class 10, 8 GB | 564072 |
| Mounting set for pipe mounting | 564596 |
| Adapter for cable glands M20x1.5 with interface connector RJ45-M12 code D | 569242 |

Examples for interconnection possibilities with other Bürkert devices

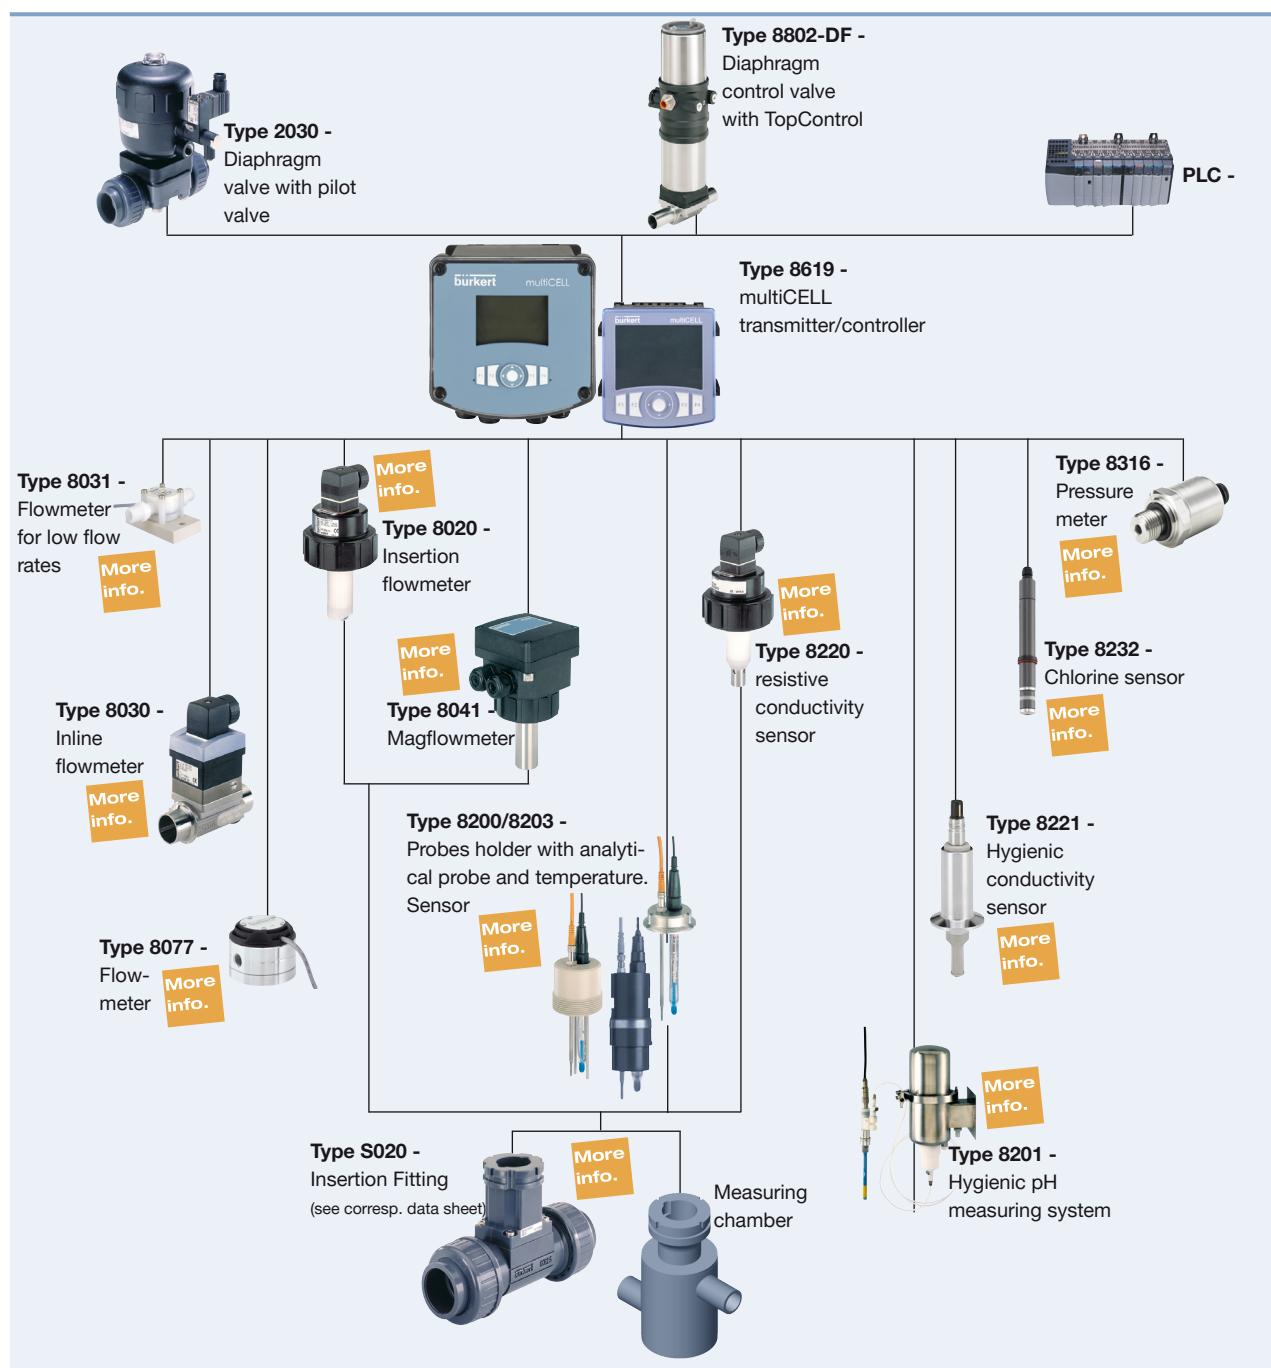

When you click on the orange box "More info." below, you will come to our website for the resp. product where you can download the data sheet.

- !** You will find more info about sensor-multiCELL connection cable in the data sheet of the selected sensor type. Please consult the corresponding data sheet.

Note

You can fill out
the fields directly
in the PDF file
before printing
out the form.

multiCELL Transmitter/controller, Type 8619 - request for quotation

Please fill out this form and send to your local Bürkert Sales Centre* with your inquiry or order

| | |
|-----------------|----------------|
| Company | Contact person |
| Customer no. | Dept. |
| Address | Tel./Fax |
| Town / Postcode | E-Mail |

8619 multiCELL transmitter/controllerQuantity Desired delivery date

| | | | | | | | |
|---|--|--------------------------|--------------------------|--------------------------|--------------------------|--------------------------|--------------------------|
| Models | <input type="checkbox"/> Panel-mounted version, 12...36 V DC <input type="checkbox"/> Wall-mounted version, 12...36 V DC <input type="checkbox"/> Wall-mounted version, 110...240 V AC | | | | | | |
| Hardware | <input type="checkbox"/> Main module ¹⁾ (without flow function; if needed please order the flow measurement software option) | | | | | | |
| | Slot | M1 | M2 | M3 | M4 | M5 | M6 |
| Ethernet module (takes up M1 and M3 slots) | | <input type="checkbox"/> | | | | | |
| Conductivity + temperature module | | <input type="checkbox"/> |
| pH/ORP + temperature module | | <input type="checkbox"/> |
| Output module ²⁾ | | <input type="checkbox"/> |
| Input module ³⁾ | | <input type="checkbox"/> |
| 1) 2 digital inputs + 2 analogue outputs + 2 transistor outputs | | | | | | | |
| 2) 2 analogue outputs + 2 transistor outputs | | | | | | | |
| 3) 2 analogue inputs + 2 digital inputs | | | | | | | |
| Software | <input type="checkbox"/> PID <input type="checkbox"/> Data logger <input type="checkbox"/> Chemical dosing* (e.g. Cooling Tower) + special batch <input type="checkbox"/> Flow measurement <input type="checkbox"/> Concentration Measurement for selected fluids <small>(only if one of the slot is equipped with a conductivity module)</small> <input type="checkbox"/> MATH function | | | | | | |
| <small>* The "Dosing" option also activates the "Flow" option if it does not exist by default in the device</small> | | | | | | | |
| Ethernet protocols | <input type="checkbox"/> Modbus TCP <input type="checkbox"/> PROFINET <input type="checkbox"/> EtherNet/IP | | | | | | |
| UL certification | <input type="checkbox"/> Yes <input type="checkbox"/> No | | | | | | |
| <small>NOTE: If a totalizer function is required then a flowmeter has to be connected via a digital input (Main module or input module)</small> | | | | | | | |

*To find your nearest Bürkert facility, click on the orange box →

www.burkert.com